

Reno-Sparks Convention & Visitors Authority
Finance Department, Purchasing Division
Phone (775) 827-7690 Fax (775) 827-7719

FROM: RENO-SPARKS CONVENTION & VISITORS AUTHORITY
Post Office Box 837
Reno, NV 89504-0837

PROJECT: RSLEC EXHIBIT HALL DEMOLITION
RFP# 2019-03

This addendum has been issued to answer questions brought up in and after the pre-bid meeting. This Addendum forms a part of the Contract Documents and modifies the original Bidding Documents dated January 15, 2019, as described below:

Addendum 1 to RFP 2019-03 is a clarification of the work that is required by the RSCVA for the demolition of the Exhibit Hall.


- A. The restroom slab and footings must be demolished, removed and resurfaced with asphalt to allow for the proper transition from the main Exhibit Hall slab and the surrounding asphalt surface. It is also necessary for the winning bidder to patch all asphalt surfaces damaged or created by the demolition to ensure that there will be a proper transition to the surrounding asphalt and that no trip hazards are created for pedestrian traffic. Installation of the new asphalt must comply with Standard Specifications For Public Works Construction.
- B. The riser for the fire suppression system is to be cut, capped and surface voids are to be filled with concrete patch to provide a level surface after removal.
- C. It is required that bollards be installed to protect the utilities (Electrical/Water) on the east and west side of the Exhibit Hall as it is currently configured. See Appendix 1.
- D. It is required that a temporary construction fence be provided and installed, before demolition begins.
- E. The Reno-Sparks Convention & Visitors Authority will be responsible for all utility disconnects prior to demolition.

ADDENDUM 1
February 4, 2019

This Addendum will become an integral part of the RFP. Respondent is required to acknowledge receipt of same by signing and returning with the original RFP document.

Firm Name _____ Signed _____.

APPENDIX 1

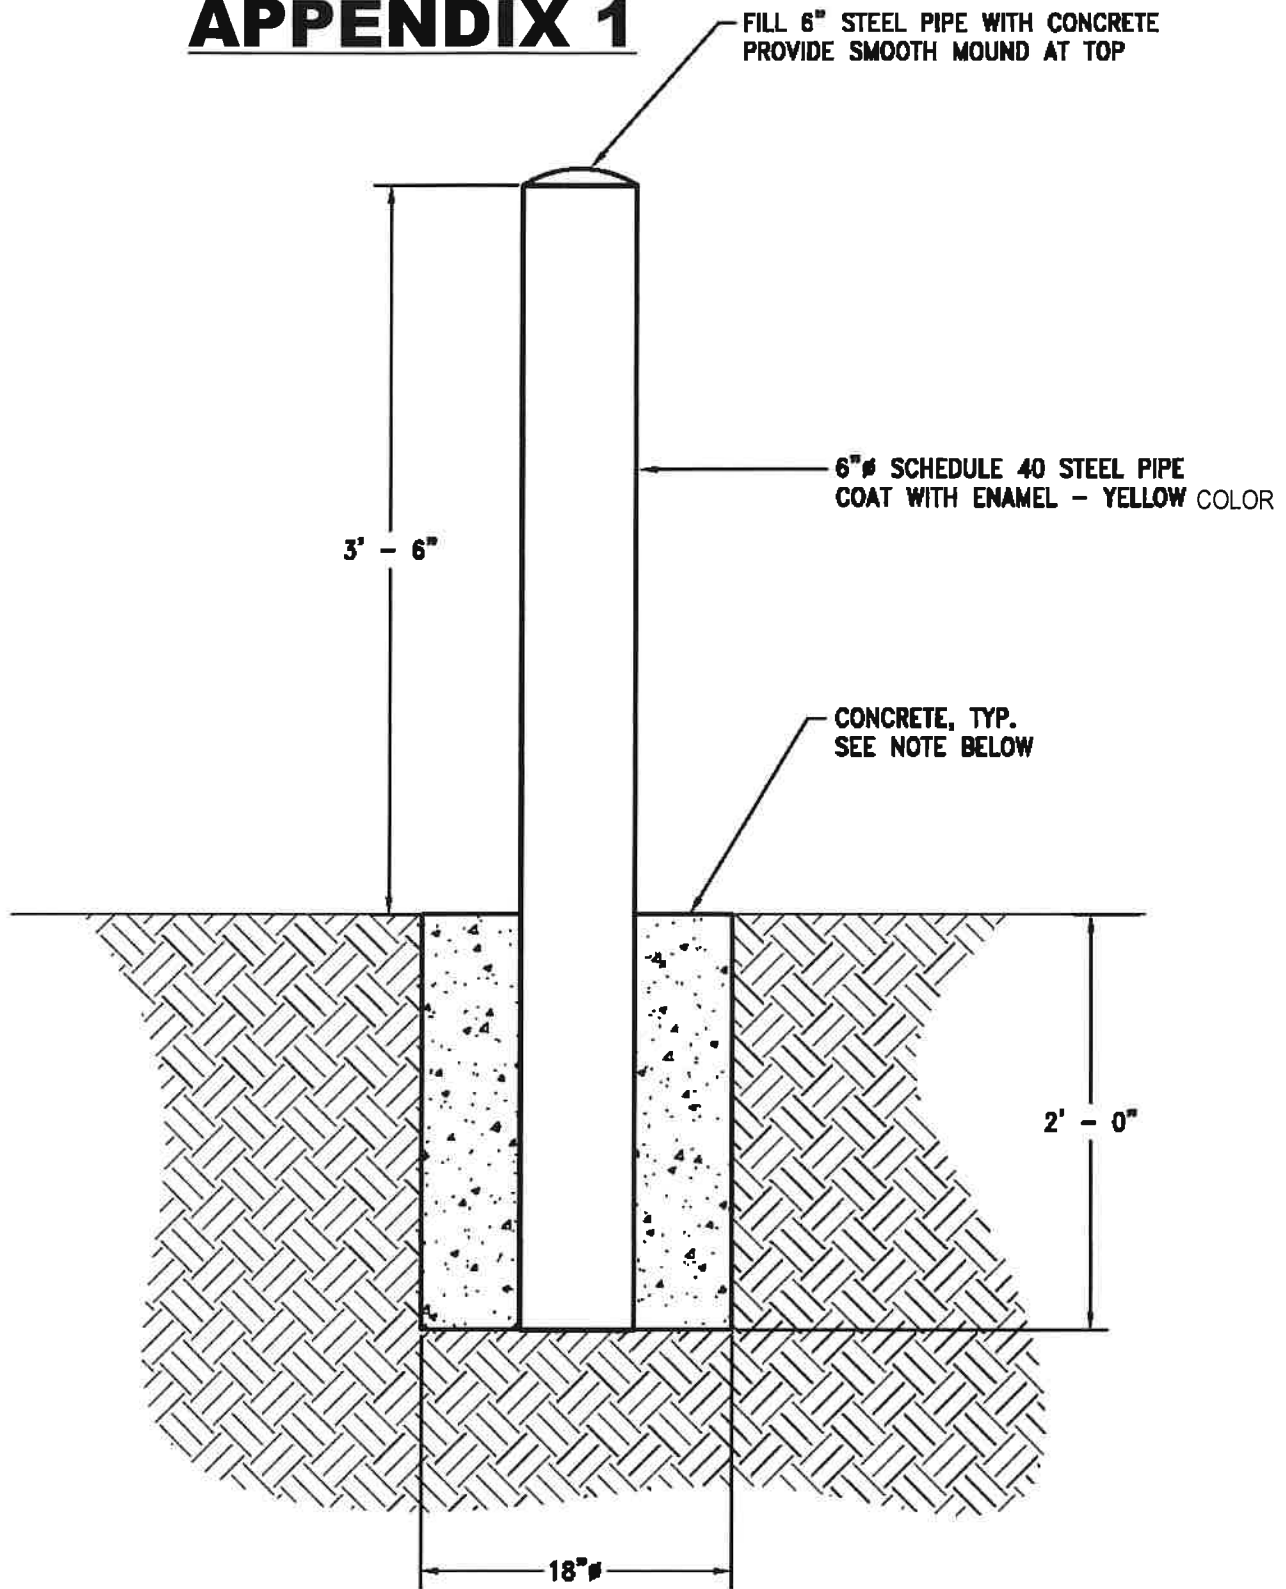

NOTE:

PORTLAND CEMENT CONCRETE (CONCRETE) SHALL HAVE THE FOLLOWING CHARACTERISTICS: 3,000 PSI MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS, MINIMUM 6 SACKS OF CEMENT PER CUBIC YARD, SLUMP AT 1 TO 4 INCHES.

BOLLARD DETAIL

SCALE: NTS